

VALIADIS S.A.

ELECTRIC MOTOR TEST REPORT - THREE PHASE INDUCTION MOTOR

NAMEPLATE DATA	IEC	TYPE	3	KW	1430	RPM
AK100L - 4 FRAME	3	PHASE	400	VOLTS	50	HZ/CYCLES
83.0 EFFICIENCY	6.36	AMPS	55	IP	IC01	IC
4 POLE	S1	DUTY	0.82	PF	N/A	EFF2
VALIADIS MANUFACTURER		SERIAL NO.	F	INS. CLASS	Y	CONNECTION

MAJOR CONTENTS	UNIT	TESE VALUE
STATOR RESISTANCE OF PHASE TO PHASE	75 DEG.C	OHM 4.2503
NO LOAD CURRENT		AMP 3.61
NO LOAD INPUT		kW 0.2678
CORE LOSS (Pfe)		kW 0.184
WINDAGE FRICTION LOSS (Pfw)		kW 0.010
STATOR WINDING LOSS(Pcu1)		kW 0.2595
ROTOR WINDING LOSS(Pcu2)		kW 0.1461
STRAY LOAD LOSS (Ps)		kW 0.0181
FULL LOAD CURRENT		AMP 6.38
LOCKED ROTOR CURRENT		AMP 45.32
LOCKED ROTOR CURRENT/FULL LOAD CURRENT		P.U. 7.1
LOCKED ROTOR INPUT @ 100% VOLT		kW 20.665
FULL LOAD TORQUE		N.m. 20.03
LOCKED ROTOR TORQUE		N.m. 57.06
LOCKED ROTOR TORQUE/FULL LOAD TORQUE		P.U. 2.85
PULL OUT TORQUE		N.m. 65.51
PULL OUT TORQUE/FULL LOAD TORQUE		P.U. 3.27
PULL UP TORQUE		N.m. 38.83
PULL UP TORQUE/FULL LOAD TORQUE		P.U. 1.94
EFFICIENCY @ FULL LOAD		% 82.93
POWER FACTOR @ FULL LOAD		0.819
FULL LOAD SLIP		4.60%
FULL LOAD SPEED		r/min 1431
STATOR WINDING TEMPERATURE RISE	30 SECS	K 55.0
DE BEARING TEMPERATURE BY PT100		Deg. C 57.0
NDE BEARING TEMPERATURE BY PT100		Deg. C 57.0
TEMPERATURE ON LEADS BY PT100		Deg. C
TEMPERATURE IN TERMINAL BOX BY PT100		Deg. C
AMBIENT TEMPERATURE BY PT100		Deg. C
SOUND PRESSURE LEVEL		dB (A) 54.1
VIBRATION		mm/s 0.5
MOMENT OF INERTIA		kgm ² 0.0067
WEIGHT		kg 27

The data above is calculated as per IEC 34-2 , all data at nominal Volts

VALIADIS S.A.	SCALE	N/A		
	DATE		REV	
AK100L- 4	DRAWN		DOCUMENT NO.	
3 kW	APPRVD			
400 VOLTS 50 Hz	CHECKED			

VALIADIS S.A.

ELECTRIC MOTOR TEST REPORT - THREE PHASE INDUCTION MOTOR

NAMEPLATE DATA	IEC	TYPE	3	KW	1430	RPM
AK100L - 4	FRAME	3	PHASE	400	VOLTS	50
83.0	EFFICIENCY	6.36	AMPS	55	IP	IC01
4	POLE	S1	DUTY	0.82	PF	N/A
VALIADIS	MANUFACTURER	SERIAL NO.	F	INS. CLASS	Y	CONNECTION

TEST DATA	NO LOAD	25% LOAD	50% LOAD	75% LOAD	100% LOAD	125% LOAD	LOCKED ROTOR
EFFICIENCY	0	71.6	80.8	83.0	82.9	81.6	
PF	0.107	0.404	0.618	0.748	0.819	0.860	0.658
RPM	1500	1484	1468	1450	1431	1408	0
SLIP	0.00%	1.07%	2.13%	3.33%	4.60%	6.13%	100.00%
AMPS	3.61	3.72	4.32	5.22	6.38	7.73	45.32
VOLTS	400	400	400	400	400	400	400
TORQUE NM	0	4.79	9.73	14.80	20.03	25.50	57.06
KW INPUT	0.2678	1.0407	1.8508	2.706	3.6196	4.6051	20.665
KW OUTPUT	0	0.745	1.496	2.246	3.002	3.759	

LOSSES (kW)	25% LOAD	50% LOAD	75% LOAD	100% LOAD	125% LOAD
STATOR LOSS Pcu1	0.088	0.119	0.174	0.260	0.381
STATOR LOSS %	8.48%	6.43%	6.42%	7.17%	1.84%
ROTOR LOSS Pcu2	0.008	0.033	0.078	0.146	0.248
ROTOR LOSS %	0.79%	1.78%	2.89%	4.04%	1.20%
CORE LOSS Pfe	0.184	0.184	0.184	0.184	0.184
CORE LOSS %	17.68%	9.94%	6.80%	5.08%	0.89%
WINDGE/FRICTION Pfw	0.010	0.010	0.010	0.010	0.010
WINDGE/FRICTION %	0.96%	0.54%	0.37%	0.28%	0.05%
STRAY LOAD LOSS Ps	0.005	0.009	0.014	0.018	0.023
STRAY LOAD LOSS %	0.50%	0.50%	0.50%	0.50%	0.50%

Losses are measured/calculated as per IEC 34-2-The Summation of Losses Method
 All data is measured at Nominal Volts

TEMPERATURES

STATOR RESISTANCE COLD	3.366 OHMS @	10.5	DEG.C.	BETWEEN STATOR LEADS
STATOR RESISTANCE ADJUSTED	4.2503 OHMS @	75	DEG.C.	BETWEEN STATOR LEADS
STATOR RESISTANCE HOT	4.12 OHMS	after test of temp rise		BETWEEN STATOR LEADS
WINDING TEMPERATURE RISE	55.0 DEG.C.	at full load steady state at		30 SECS
WINDING TEMPERATURE RISE	DEG.C.	at full load steady state at		0 SECS
PT100 TEMPERATURE OF DE WINDING	DEG.C.	at full load steady state at ambient		DEG.C.
PT100 TEMPERATURE OF NDE WINDING	DEG.C.	at full load steady state at ambient		DEG.C.
PT100 TEMPERATURE OF DE BEARING	57.0 DEG.C.	at full load steady state at ambient		10.5 DEG.C.
PT100 TEMPERATURE OF NDE BEARING	57.0 DEG.C.	at full load steady state at ambient		10.5 DEG.C.
PT100 TEMPERATURE OF IN TERMINAL BOX	DEG.C.	at full load steady state at ambient		DEG.C.
PT100 TEMPERATURE OF ON STATOR LEAD	DEG.C.	at full load steady state at ambient		DEG.C.

OTHER

NOISE LEVEL (Lp)	54.1	dB(A) 1meter	INSULATION RESISTANCE	500	MEG.OHMS
VIBRATION LEVEL	0.5	mm/sec on no load	D.E. BEARING		
WEIGHT	27	kg	N.D.E. BEARING		
H-POT TEST VOLTS	1800	VOLTS			

VALIADIS S.A.		SCALE	N/A	
		DATE		REV
AK100L - 4 3 kW 400 VOLTS 50 Hz		DRAWN		DOCUMENT NO.
		APPRVD		
		CHECKED		



RESULT SUMMARY

VALIADIS S.A.


ELECTRIC MOTOR TEST REPORT - THREE PHASE INDUCTION MOTOR

NAMEPLATE DATA	IEC	TYPE	3	KW	1430	RPM
AK100L-4	FRAME	3	PHASE	400	VOLTS	50
83.0	EFFICIENCY	6.36	AMPS	55	IP	IC01
4	POLE	S1	DUTY	0.82	PF	N/A
VALIADIS	MANUFACTURER	SERIAL NO.	F	INS. CLASS	Y	CONNECTION

LOAD TEST

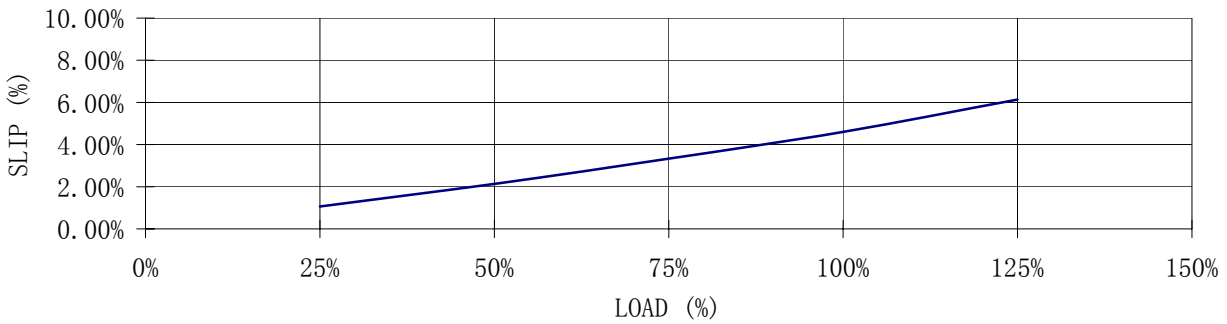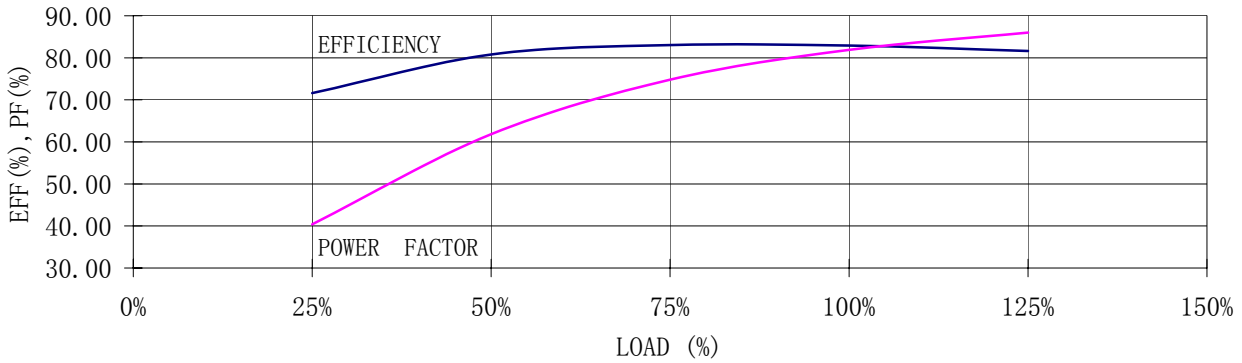

SPEED VS TORQUE, CURRENT

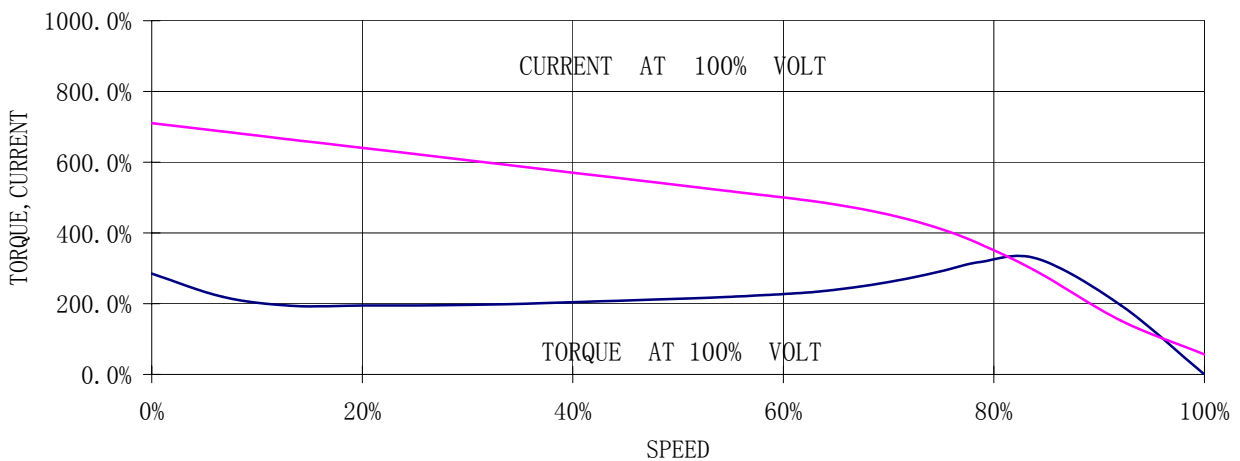



	VALIADIS S.A.			SCALE	N/A	
				DATE		REV
	AK100L - 4			DRAWN		DOCUMENT NO.
	3		kW	APPRVD		
	400	VOLTS	50	Hz	CHECKED	

VALIADIS S.A.

ELECTRIC MOTOR TEST REPORT - THREE PHASE INDUCTION MOTOR

NAMEPLATE DATA	IEC	TYPE	3	KW	1430	RPM
AK100L - 4	FRAME	3	PHASE	400	VOLTS	50
83.0	EFFICIENCY	6.36	AMPS	55	IP	IC01
4	POLE	S1	DUTY	0.82	PF	N/A
VALIADIS	MANUFACTURER	SERIAL NO.	F	INS. CLASS	Y	CONNECTION

NO LOAD TEST

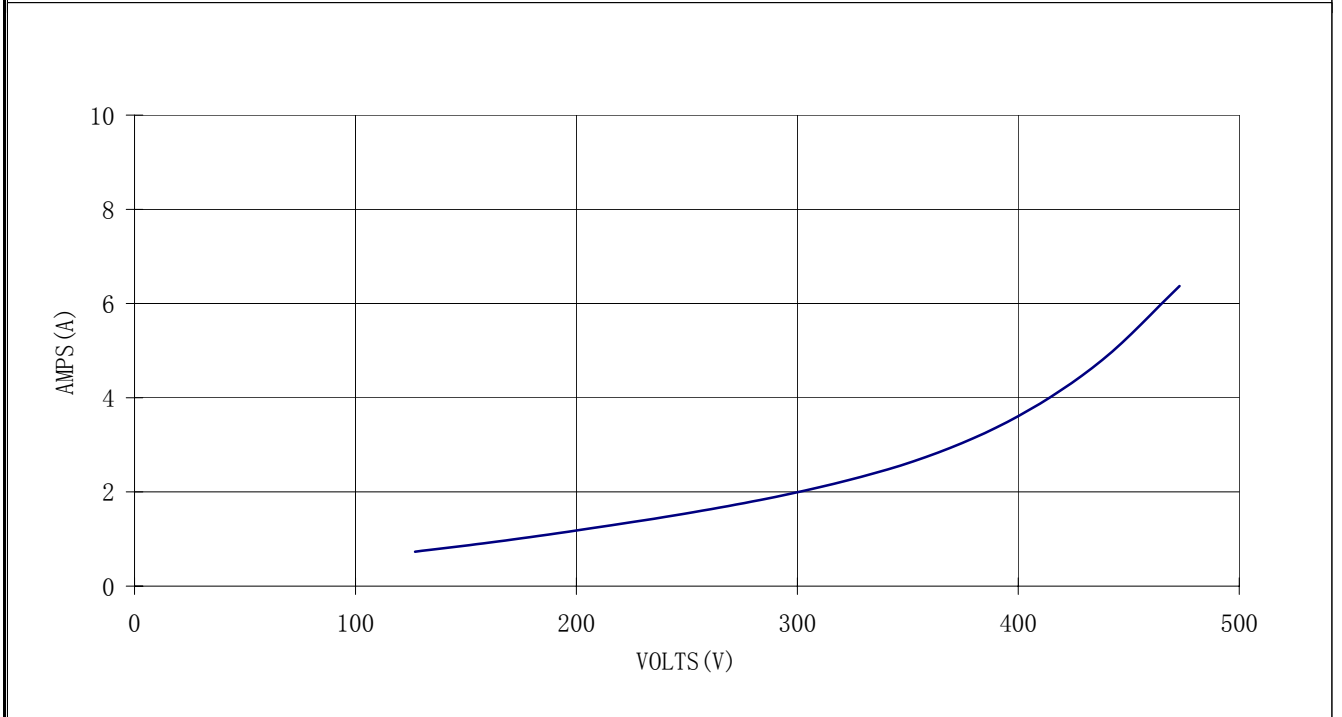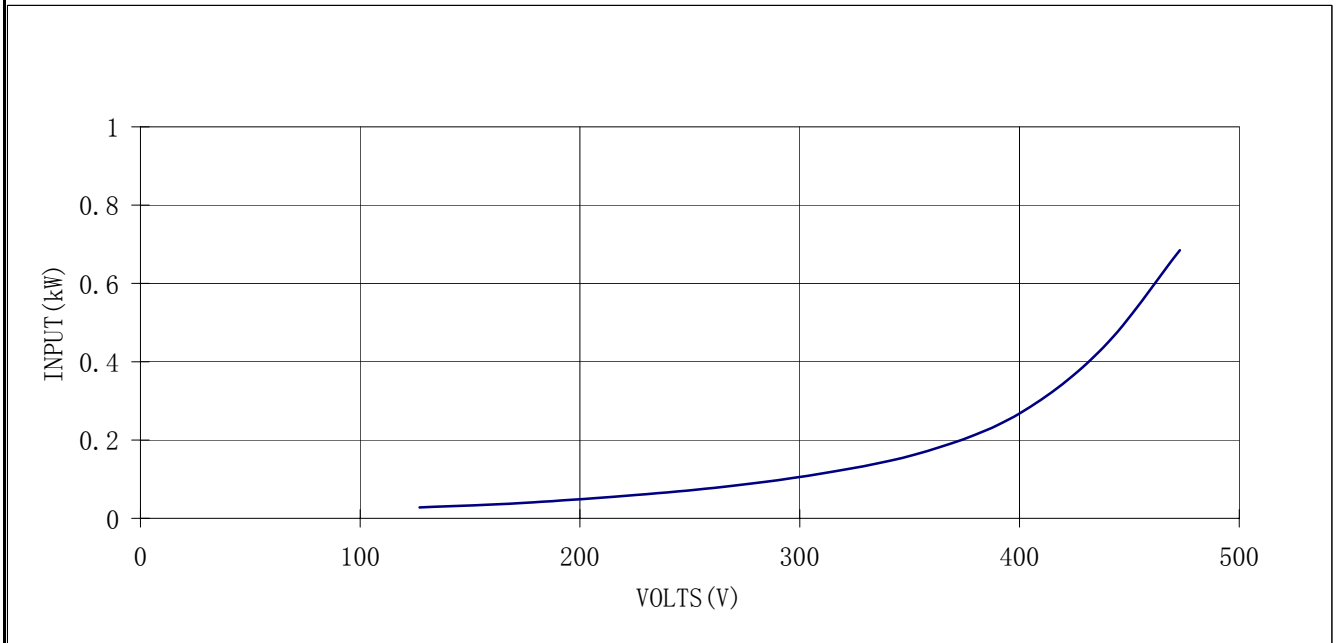

	VALIADIS S.A.			SCALE	N/A	
				DATE		REV
	AK100L- 4			DRAWN		DOCUMENT NO.
	3	kW		APPRVD		
400	VOLTS	50	CHECKED			

CURVE